



October 21, 2025

Mr. Jason Bing, RA, LEED AP
Director, Capital Programs
Ann Arbor Public Schools
2555 South State Street
Ann Arbor, MI 48104
BingJ@aaps.k12.mi.us

RE: AEG Project #AE250927
Radon Sampling Services
Ann Arbor Public Schools, Clague Middle School

Dear Mr. Bing:

Pursuant to the request of Ann Arbor Public Schools, Arch Environmental Group, Inc. (AEG) placed short-term radon detectors throughout frequently occupied locations at ground level or lower throughout Clague Middle School. The detectors were placed in the facility on October 10, 2025 and were retrieved on October 16, 2025. Samples were analyzed by Air Chek, Inc. located in Mills River, North Carolina.

I. Introduction

The U.S. Environmental Protection Agency (EPA) and other major national and international scientific organizations have concluded that radon is a human carcinogen and a serious environmental health problem. Radon is a naturally occurring radioactive gas. It comes from the natural breakdown (decay) of uranium which is found in soil and rock all over the United States. Radon travels through soil and enters buildings through cracks and other holes in the foundation. Eventually it decays into radioactive particles (decay products) that can become trapped in your lungs when you breathe. As these particles in turn decay, they release small bursts of radiation. The radiation can damage lung tissue and lead to lung cancer over the course of your lifetime. Radon is colorless, odorless, and tasteless. The only way to know whether or not elevated levels of radon are present in a location is to test.

There are two ways to test for radon:

1. A **short-term test** is the quickest test for radon. In this test the device remains in the room for a period of **2 to 90 days** depending on the device.
2. A **long-term test** remains in place for more than 90 days.

The EPA recommends that action should be taken when radon levels are found to be 4pCi/L (Pico Curies per Liter of air) or higher.

II. Sampling Analysis & Strategies

In an effort to determine the radon levels throughout frequently occupied areas at ground level or lower, Arch Environmental Group, Inc. deposited short-term, activated charcoal adsorption devices (AC) in seventy-seven locations in Clague Middle School.

Activated charcoal adsorption devices (ACs) are a passive detector system for the measurement of radon concentrations in the air. Once the detector is opened, radon gas diffuses passively onto the activated charcoal and radon concentration is determined. ACs are passive devices. The charcoal within these devices has been treated to increase its ability to adsorb gases. The passive nature of the activated charcoal allows continual adsorption and desorption of radon. During the entire measurement period (typically two to seven days), the adsorbed radon undergoes radioactive decay. AEG deposited the AC detectors on October 10, 2025. The detectors were placed between knee and shoulder height on a flat or hanging surface. Additionally, the detectors were placed at least 1 foot from exterior walls, 3 feet from windows or doors, away from direct sunlight and away from heat vents. After a designated time, the samples were retrieved on October 16, 2025; the AC detectors were closed and collected for laboratory analysis. Duplicate samples and blank samples necessary for quality assurance purposes were also collected at the facility.

As the sample results shown in *Attachment A* indicate, all samples identified radon concentrations below the EPA recommended "action level" of 4.0 pCi/L with sample results ranging from <0.3 pCi/L to 2.3 pCi/L. One sample, collected in the Enrollment Office, was not located during sample retrieval. Prudent practice recommends that areas where radon levels are potentially above the "action level" should be retested with a second short-term test to confirm the results of the initial test. A second test above the "action level" recommends either progressing to a long-term test of at least 90 days or taking corrective measures to reduce levels below the "action level".

III. Conclusions

Pursuant to the request of Ann Arbor Public Schools, Arch Environmental Group, Inc. collected radon samples from frequently occupied areas throughout Clague Middle School. In accordance with the guidance document titled "Radon Measurements in Schools, Revised Edition (EPA 402-R-92-014, July 1993)" published by the U.S. Environmental Protection Agency, *"...the EPA has conducted extensive research on the presence and measurement of radon in schools. Initial reports from some of those studies prompted the Administrator in 1989 to recommend that schools nationwide be tested for the presence of radon. Based on more recent findings, EPA continues to advise U.S. schools to test for radon and to reduce levels to below 4pCi/L."* Following some of the sampling recommendations offered by this guidance document, Arch Environmental Group, Inc.'s samples collected during this round were all determined to be below 4 pCi/L.

The EPA suggests that schools retest sometime in the future, especially after significant changes to the building structure or the HVAC system.

If you have any question regarding this information or work performed by Arch Environmental Group, Inc., please feel free to contact me at (248) 426-0165 ext. "330" [office] or (248) 252-3618 [mobile].

Sincerely,

HealthAIR
A Division of arch environmental group



Philip E. Grosse
Project Consultant III



Attachment A
Official Laboratory Results

Radon test result report for:**AAPS
CLAGUE MS**

Kit #	Room Id	Started	Ended	pCi/L	Analyzed
7531736	120	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531737	120 DUP	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531739	120 EAST	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531738	120 WEST	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531740	121	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531741	121 STORAGE	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531748	124	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531749	126	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531750	127	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531751	127 EAST	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531752	127 WEST	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531753	129	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531755	130	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531756	131	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531757	131 DUP	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531754	133	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531759	134	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.9 ± 0.3	2025-10-20
7531760	135	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531761	136	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7540645	138	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7540644	138 DUP	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7540643	138 PRACTICE	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7540642	138 STORAGE	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7540636	139	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7540634	139 EAST	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.9 ± 0.3	2025-10-20
7540633	139 EAST DUP	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.6 ± 0.3	2025-10-20
7540635	139 PRACTICE	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7540632	139 WEST	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7540608	141	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	0.7 ± 0.3	2025-10-20
7540609	142	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	0.5 ± 0.3	2025-10-20
7540611	143	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	0.7 ± 0.3	2025-10-20
7540610	144	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.8 ± 0.3	2025-10-20
7540614	145	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.5 ± 0.3	2025-10-20
7540613	145 DUP	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.2 ± 0.3	2025-10-20
7540621	146	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	0.5 ± 0.3	2025-10-20
7531731	ASST PRIN.	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.8 ± 0.3	2025-10-20
7540619	ATHLETIC OFF	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20

Radon test result report for:**AAPS****CLAGUE MS**

Kit #	Room Id	Started	Ended	pCi/L	Analyzed
7540618	ATHLETIC STO	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540607	BLANK 1	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540606	BLANK 2	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540605	BLANK 3	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540604	BLANK 4	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540603	BLANK 5	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7531721	BLDG MGR	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	1.2 ± 0.3	2025-10-20
7531763	BLUE CONF	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.8 ± 0.3	2025-10-20
7531762	BLUE HOUSE	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7540646	BLUE PHONE	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7540631	BOILER RM	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7531729	CLAGUE CON	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.7 ± 0.3	2025-10-20
7531723	CLINIC	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.6 ± 0.3	2025-10-20
7531734	COMM. ASST	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.7 ± 0.3	2025-10-20
7531720	CONFERENCE	2025-10-10 @ 11:00 am	2025-10-16 @ 12:00 pm	0.9 ± 0.3	2025-10-20
7531735	COUNSEL	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	< 0.3	2025-10-20
7540620	CUST. OFF	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	0.8 ± 0.3	2025-10-20
7540622	DRY GOODS	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7531726	FILE	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	< 0.3	2025-10-20
7531727	FILE DUP	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	< 0.3	2025-10-20
7540617	GYM	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	0.7 ± 0.3	2025-10-20
7540630	INSTR. STO.	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.8 ± 0.3	2025-10-20
7540624	KIT OFF	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	0.6 ± 0.3	2025-10-20
7540623	KIT OFF DUP	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7531719	MAIL RM	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.7 ± 0.3	2025-10-20
7540629	MAIN ELEC	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	1.2 ± 0.3	2025-10-20
7531718	MAIN OFF	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.9 ± 0.3	2025-10-20
7531747	MC STO DUP	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7531746	MC STORAGE	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7531744	MEDIA CTR	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7531745	MEDIA KIT	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7540626	MPR	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540628	MR 140	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	< 0.3	2025-10-20
7540637	MUSIC LIB.	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.6 ± 0.3	2025-10-20
7540641	MUSIC OFF.	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7531722	NURSE	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.9 ± 0.3	2025-10-20
7531728	OFF. BY FILE	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.7 ± 0.3	2025-10-20

October 20, 2025

**** LABORATORY ANALYSIS REPORT ****

Radon test result report for:

AAPS

CLAGUE MS

Kit #	Room Id	Started	Ended	pCi/L	Analyzed
7531732	OFF. SUPPLY	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	< 0.3	2025-10-20
7540638	PRACTICE 1	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.7 ± 0.3	2025-10-20
7540639	PRACTICE 2	2025-10-10 @ 1:00 pm	2025-10-16 @ 11:00 am	0.5 ± 0.3	2025-10-20
7540640	PRACTICE 3	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	0.6 ± 0.3	2025-10-20
7531724	PRINCIPAL	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	1.0 ± 0.3	2025-10-20
7540627	PROP STO	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	1.4 ± 0.3	2025-10-20
7531730	PSYCH.	2025-10-10 @ 11:00 am	2025-10-16 @ 12:00 pm	0.7 ± 0.3	2025-10-20
7540615	PUMP RM	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.6 ± 0.3	2025-10-20
7540616	RECEIVING	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.3 ± 0.3	2025-10-20
7531725	RECORDS	2025-10-10 @ 11:00 am	2025-10-16 @ 10:00 am	0.6 ± 0.3	2025-10-20
7540612	ROBOTICS	2025-10-10 @ 2:00 pm	2025-10-16 @ 12:00 pm	1.8 ± 0.3	2025-10-20
7531743	SCI. OFF	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531742	SCIENCE STO	2025-10-10 @ 11:00 am	2025-10-16 @ 11:00 am	< 0.3	2025-10-20
7531758	SM ELEC	2025-10-10 @ 12:00 pm	2025-10-16 @ 11:00 am	2.3 ± 0.3	2025-10-20
7540625	STAGE	2025-10-10 @ 1:00 pm	2025-10-16 @ 12:00 pm	0.5 ± 0.3	2025-10-20

Air Chek 1936 Butler Bridge Rd, Mills River, NC 28759-3892 Phone: (828) 684-0893 Fax: (828) 684-8498

Kit Number	Start Date	Start Time	End Date	End Time	Temperature	Facility	Building	Room	Project ID
7531718	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	MAIN OFF	AE250927
7531719	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	MAIL RM	AE250927
7531720	2025-10-16	11:00 am	2025-10-16	12:00 pm	70	AAPS	CLAGUE	CONFERENCE	AE250927
7531721	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	BLDG MG	AE250927
7531722	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	NURSE	AE250927
7531723	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	CLINIC	AE250927
7531724	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	PRINCIPAL	AE250927
7531725	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	RECORDS	AE250927
7531726	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	FILE	AE250927
7531727	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	FILE DUP	AE250927
7531728	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	OFF. BY F	AE250927
7531729	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	CLAGUE C	AE250927
7531730	2025-10-16	11:00 am	2025-10-16	12:00 pm	70	AAPS	CLAGUE	PSYCH.	AE250927
7531731	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	ASST PRI	AE250927
7531732	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	OFF. SUP	AE250927
7531734	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	COMM. AS	AE250927
7531735	2025-10-16	11:00 am	2025-10-16	10:00 am	70	AAPS	CLAGUE	COUNSEL	AE250927
7531736	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	120	AE250927
7531737	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	120 DUP	AE250927
7531738	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	120 WEST	AE250927
7531739	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	120 EAST	AE250927
7531740	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	121	AE250927
7531741	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	121 STOR	AE250927
7531742	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	SCIENCE	AE250927
7531743	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	SCI. OFF	AE250927
7531744	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	MEDIA CT	AE250927
7531745	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	MEDIA KIT	AE250927
7531746	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	MC STOR	AE250927
7531747	2025-10-16	11:00 am	2025-10-16	11:00 am	70	AAPS	CLAGUE	MC STO D	AE250927
7531748	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	124	AE250927
7531749	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	126	AE250927
7531750	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	127	AE250927
7531751	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	127 EAST	AE250927
7531752	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	127 WEST	AE250927
7531753	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	129	AE250927
7531754	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	133	AE250927
7531755	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	130	AE250927
7531756	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	131	AE250927
7531757	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	131 DUP	AE250927
7531758	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	SM ELEC	AE250927
7531759	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	134	AE250927
7531760	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	135	AE250927
7531761	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	136	AE250927
7531762	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	BLUE HO	AE250927
7531763	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE	BLUE COM	AE250927
7540603	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	BLANK 5	AE250927
7540604	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	BLANK 4	AE250927
7540605	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	BLANK 3	AE250927
7540606	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	BLANK 2	AE250927
7540607	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	BLANK 1	AE250927
7540608	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE	141	AE250927

7540609	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	142	AE250927
7540610	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	144	AE250927
7540611	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	143	AE250927
7540612	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	ROBOTIC	AE250927
7540613	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	145 DUP	AE250927
7540614	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	145	AE250927
7540615	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	PUMP RM	AE250927
7540616	2025-10-16	2:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	RECEIVIN	AE250927
7540617	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	GYM	AE250927
7540618	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	ATHLETIC	AE250927
7540619	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	ATHLETIC	AE250927
7540620	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	CUST. OF	AE250927
7540621	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	146	AE250927
7540622	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	DRY GOO	AE250927
7540623	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	KIT OFF D	AE250927
7540624	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	KIT OFF	AE250927
7540625	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	STAGE	AE250927
7540626	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	MPR	AE250927
7540627	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	PROP STC	AE250927
7540628	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	MR 140	AE250927
7540629	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	MAIN ELE	AE250927
7540630	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	INSTR. ST	AE250927
7540631	2025-10-16	1:00 pm	2025-10-16	12:00 pm	70	AAPS	CLAGUE M	BOILER R	AE250927
7540632	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	139 WEST	AE250927
7540633	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	139 EAST	AE250927
7540634	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	139 EAST	AE250927
7540635	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	139 PRAC	AE250927
7540636	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	139	AE250927
7540637	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	MUSIC LIB	AE250927
7540638	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	PRACTICE	AE250927
7540639	2025-10-16	1:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	PRACTICE	AE250927
7540640	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	PRACTICE	AE250927
7540641	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	MUSIC OF	AE250927
7540642	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	138 STOR	AE250927
7540643	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	138 PRAC	AE250927
7540644	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	138 DUP	AE250927
7540645	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	138	AE250927
7540646	2025-10-16	12:00 pm	2025-10-16	11:00 am	70	AAPS	CLAGUE M	BLUE PHC	AE250927

Floor	Result	Variance	Analysis N	Analysis D	%Moisture	Street	City	State	ZIP
1	0.9	0.3		2025-10-2	4.5				
1	0.7	0.3		2025-10-2	4.3				
1	0.9	0.3		2025-10-2	4.4				
1	1.2	0.3		2025-10-2	4.4				
1	0.9	0.3		2025-10-2	5.2				
1	0.6	0.3		2025-10-2	4.4				
1	1	0.3		2025-10-2	4.5				
1	0.6	0.3		2025-10-2	3.6				
1	< 0.3	0.3		2025-10-2	4.5				
1	< 0.3	0.3		2025-10-2	5.2				
1	0.7	0.3		2025-10-2	5.1				
1	0.7	0.3		2025-10-2	4.4				
1	0.7	0.3		2025-10-2	4.4				
1	0.8	0.3		2025-10-2	4.4				
1	< 0.3	0.3		2025-10-2	5.2				
1	0.7	0.3		2025-10-2	3.7				
1	< 0.3	0.3		2025-10-2	3.6				
1	< 0.3	0.3		2025-10-2	4.5				
1	< 0.3	0.3		2025-10-2	5.3				
1	< 0.3	0.3		2025-10-2	4.5				
1	< 0.3	0.3		2025-10-2	4.3				
1	< 0.3	0.3		2025-10-2	5.3				
1	< 0.3	0.3		2025-10-2	4.4				
1	< 0.3	0.3		2025-10-2	3.7				
1	< 0.3	0.3		2025-10-2	4.4				
1	0.7	0.3		2025-10-2	4.4				
1	0.5	0.3		2025-10-2	4.4				
1	0.7	0.3		2025-10-2	4.5				
1	0.7	0.3		2025-10-2	4.5				
1	< 0.3	0.3		2025-10-2	4.5				
1	< 0.3	0.3		2025-10-2	3.7				
1	< 0.3	0.3		2025-10-2	4.4				
1	< 0.3	0.3		2025-10-2	5.3				
1	< 0.3	0.3		2025-10-2	5.2				
1	< 0.3	0.3		2025-10-2	5.2				
1	< 0.3	0.4		2025-10-2	5.3				
1	< 0.3	0.3		2025-10-2	6.7				
1	< 0.3	0.3		2025-10-2	5.3				
1	< 0.3	0.3		2025-10-2	5.1				
1	2.3	0.3		2025-10-2	5.1				
0	0.9	0.3		2025-10-2	5.1				
1	< 0.3	0.3		2025-10-2	5.9				
1	< 0.3	0.3		2025-10-2	6				
1	0.7	0.3		2025-10-2	5.2				
1	0.8	0.3		2025-10-2	5.2				
3	< 0.3	0.3		2025-10-2	1.2				
3	< 0.3	0.3		2025-10-2	1.2				
3	< 0.3	0.3		2025-10-2	1.2				
3	< 0.3	0.3		2025-10-2	2.1				
3	< 0.3	0.3		2025-10-2	1.2				
1	0.7	0.3		2025-10-2	3.7				

1	0.5	0.3		2025-10-21	3.6				
1	1.8	0.3		2025-10-21	4.5				
1	0.7	0.3		2025-10-21	3.7				
1	1.8	0.3		2025-10-21	3.7				
1	1.2	0.3		2025-10-21	4.3				
1	1.5	0.3		2025-10-21	4.5				
1	1.6	0.3		2025-10-21	5.2				
1	1.3	0.3		2025-10-21	5.2				
1	0.7	0.3		2025-10-21	2.9				
1	< 0.3	0.3		2025-10-21	4.4				
1	< 0.3	0.3		2025-10-21	4.5				
1	0.8	0.3		2025-10-21	3.6				
1	0.5	0.3		2025-10-21	3.7				
1	< 0.3	0.3		2025-10-21	3.6				
1	< 0.3	0.3		2025-10-21	3.7				
1	0.6	0.3		2025-10-21	2.9				
1	0.5	0.3		2025-10-21	4.4				
1	< 0.3	0.3		2025-10-21	2.9				
1	1.4	0.3		2025-10-21	5.2				
1	< 0.3	0.3		2025-10-21	4.3				
1	1.2	0.3		2025-10-21	3.6				
1	0.8	0.3		2025-10-21	5.2				
1	< 0.3	0.3		2025-10-21	5.8				
1	< 0.3	0.3		2025-10-21	4.3				
1	0.6	0.3		2025-10-21	5.1				
1	0.9	0.3		2025-10-21	5.2				
1	< 0.3	0.3		2025-10-21	5.2				
1	< 0.3	0.3		2025-10-21	5.2				
1	0.6	0.3		2025-10-21	4.5				
1	0.7	0.3		2025-10-21	5.2				
1	0.5	0.3		2025-10-21	4.5				
1	0.6	0.3		2025-10-21	4.4				
1	0.5	0.3		2025-10-21	4.5				
1	0.5	0.3		2025-10-21	4.4				
1	0.7	0.3		2025-10-21	3.6				
1	0.5	0.3		2025-10-21	4.5				
1	0.5	0.3		2025-10-21	5.2				
1	< 0.3	0.3		2025-10-21	4.4				




Attachment B
Sample Location Maps

<u>AC</u> : ART CLASSROOM	<u>GLK</u> : GIRLS LOCKER ROOM	<u>O</u> : OFFICE
<u>AV</u> : AUDIO/VISUAL	<u>GYM</u> : GYMNASIUM	<u>PL</u> : PLATFORM
<u>BLK</u> : BOYS LOCKER ROOM	<u>K</u> : KITCHEN	<u>S</u> : STORAGE
<u>C</u> : CLASSROOM	<u>KI</u> : KILN	<u>SR</u> : STAIRS
<u>CAF</u> : CAFETERIA	<u>L</u> : LOBBY	<u>TH</u> : THEATER
<u>CC</u> : CLINIC	<u>MC</u> : MEDIA CENTER	<u>TL</u> : TEACHER LOUNGE
<u>CR</u> : COMPUTER LAB	<u>ME</u> : MECHANICAL ROOM	<u>W</u> : WORKROOM
<u>EL</u> : ELEVATOR	<u>MP</u> : MULTIPURPOSE ROOM	
<u>G</u> : GENERAL OFFICE	<u>MR</u> : MUSIC ROOM	

A6250927

10/10 - 10/16/2025

X = SAMPLE LOCATION

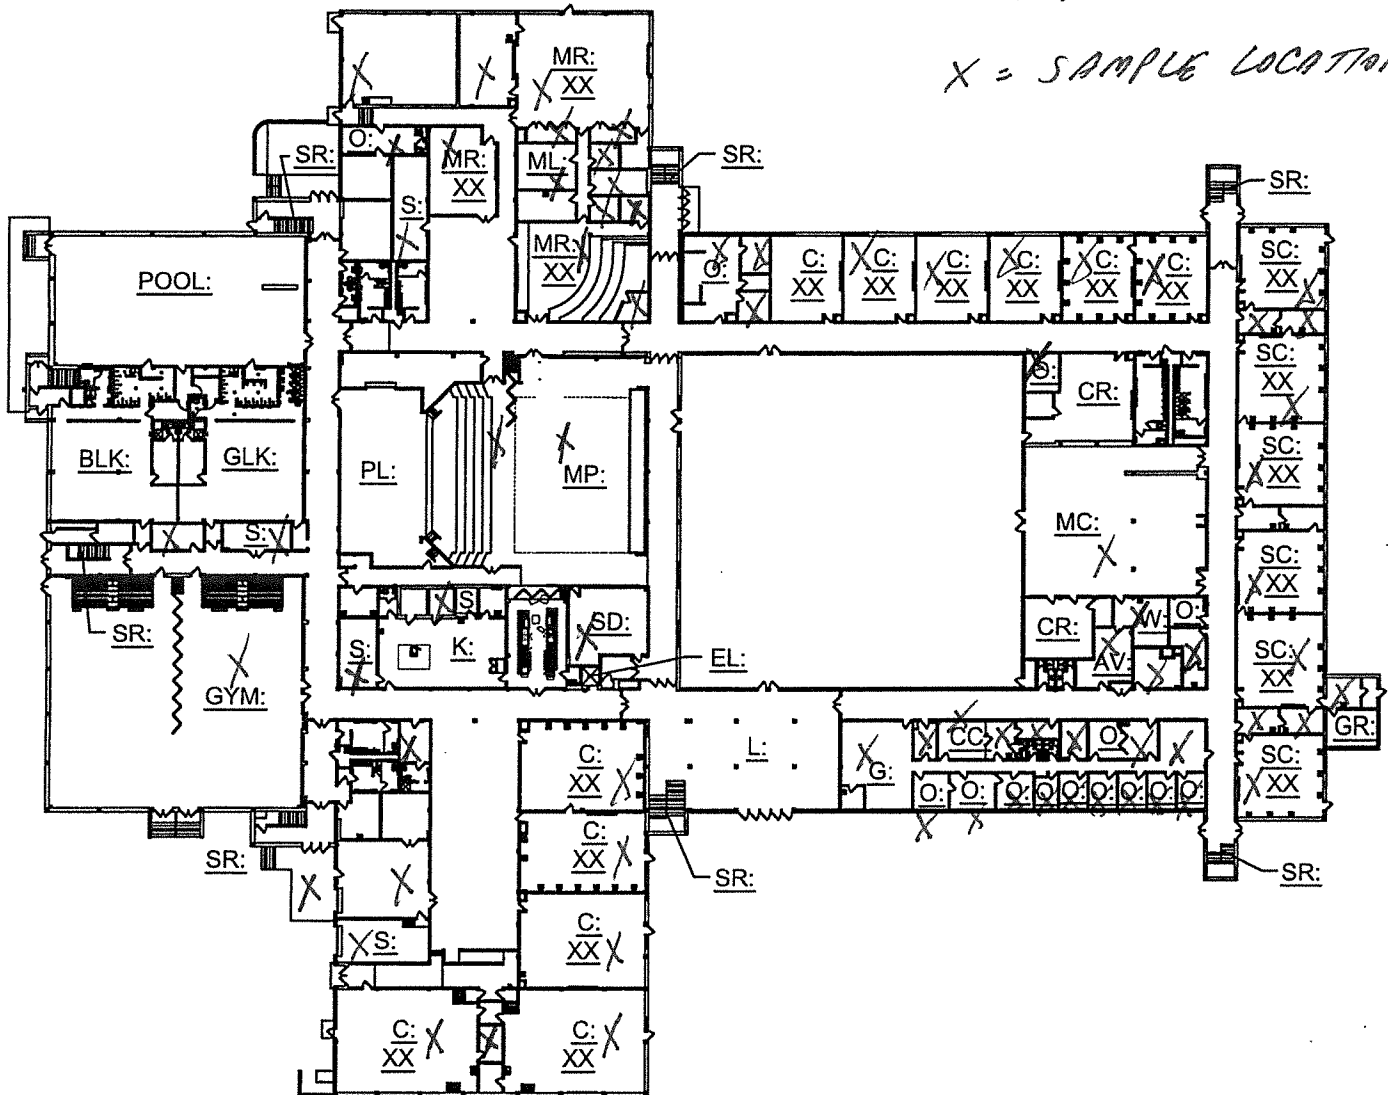

 : BARRIER-FREE ENTRANCE


 : KEYPAD DOOR ACCESS
 : PROX READER DOOR ACCESS

FIRST FLOOR PLAN

Clague Middle School

Ann Arbor Public Schools


Mitchell and Mouat Architects



0 64
SCALE: FEET

FEBRUARY 2013

1st Floor

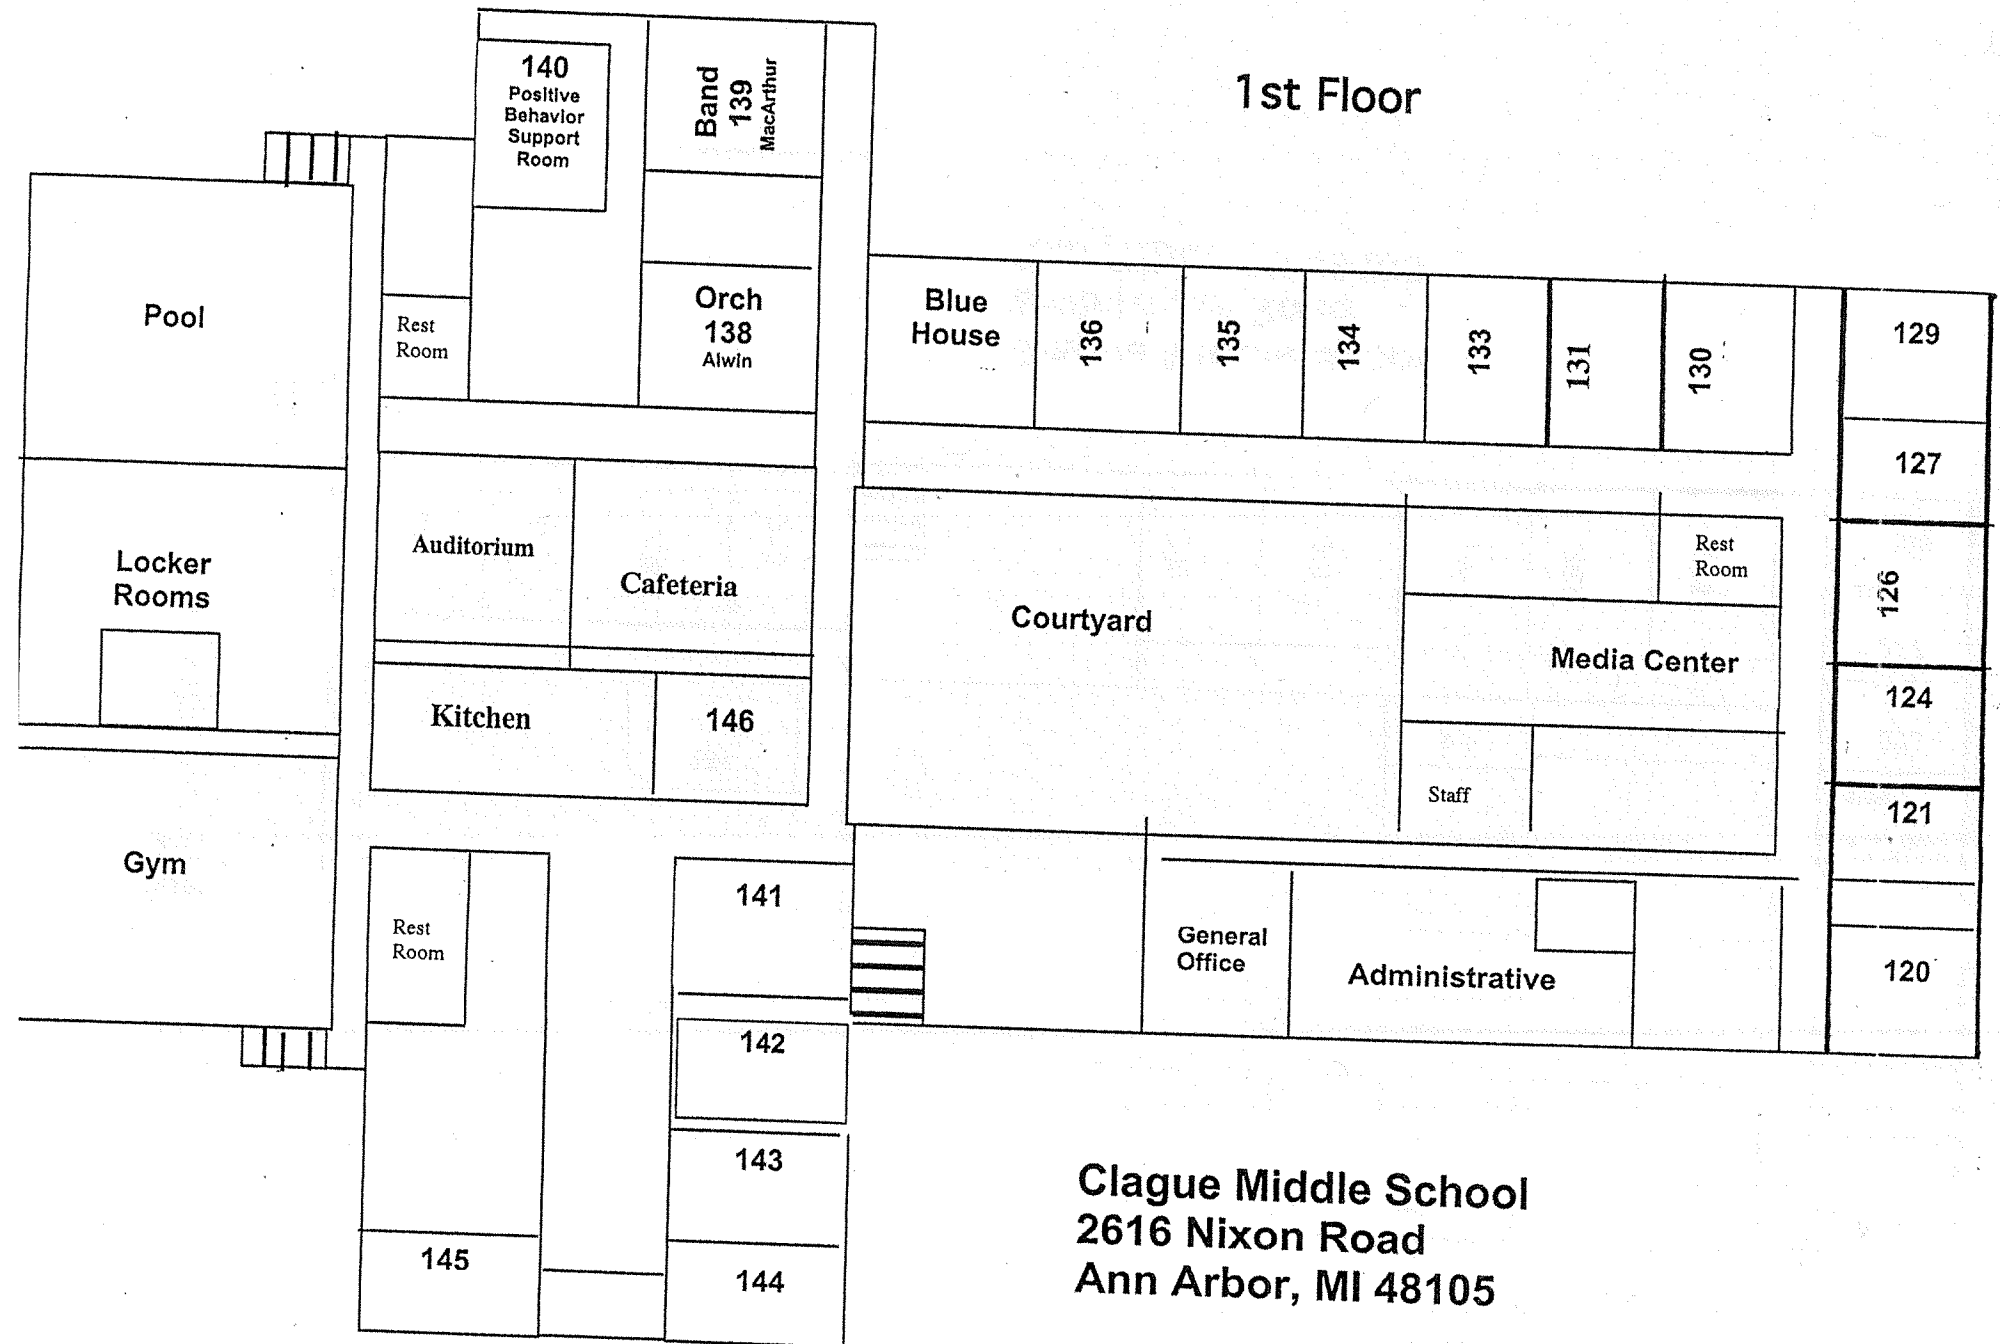

Clague Middle School
2616 Nixon Road
Ann Arbor, MI 48105